

Hans Berger

Automating with STEP 7 in STL and SCL

SIMATIC S7-300/400
Programmable Controllers

SIEMENS

```
i) := Address; k := -1;
```

```
REPEAT
```

```
  k := 1;
```

```
  IF 8 THEN := 0;
```

```
  UNTIL = Address + OR (I[i
```

```
END_REPEAT
```

```
byteindex i; b index
```

```
U "Eingang6"
```

```
UN "Zeit
```

```
S5T#2S
```

```
S "Z 7"
```

```
U "Z 7"
```

```
= "Aus 6"
```

```
U "Eingang6"
```

```
UN "Zeit7"
```

```
LM S5T#2S
```

```
SI "Zeit6"
```

Fifth Edition

Berger Automating with STEP 7 in STL and SCL

Automating with STEP 7 in STL and SCL

Programmable Controllers
SIMATIC S7-300/400

by Hans Berger

6th revised and enlarged edition, 2012

Publicis Publishing

Bibliographic information published by the Deutsche Nationalbibliothek

The Deutsche Nationalbibliothek lists this publication in the Deutsche Nationalbibliografie;
detailed bibliographic data are available in the Internet at <http://dnb.d-nb.de>.

This book contains one Trial DVD. **“SIMATIC STEP 7 Professional, Edition 2010 SR1, Trial License”** encompasses: SIMATIC STEP 7 V5.5 SP1, S7-GRAPH V5.3 SP7, S7-SCL V5.3 SP6, S7-PLCSIM V5.4 SP5 and can be used for trial purposes for 14 days.

This Software can only be used with the Microsoft Windows XP 32 Bit Professional Edition SP3 or Microsoft Windows 7 32/64 Bit Professional Edition SP1 or Microsoft Windows 7 32/64 Bit Ultimate Edition SP1 operating systems.

Additional information can be found in the Internet at:

<http://www.siemens.com/sce/contact>

<http://www.siemens.com/sce/modules>

<http://www.siemens.com/sce/tp>

The programming examples concentrate on describing the STL and SCL functions and providing SIMATIC S7 users with programming tips for solving specific tasks with this controller.

The programming examples given in the book do not pretend to be complete solutions or to be executable on future STEP 7 releases or S7-300/400 versions. Additional care must be taken in order to comply with the relevant safety regulations.

The author and publisher have taken great care with all texts and illustrations in this book.

Nevertheless, errors can never be completely avoided. The publisher and the author accept no liability, regardless of legal basis, for any damage resulting from the use of the programming examples.

The author and publisher are always grateful to hear your responses to the contents of the book.

Publicis Publishing

P.O. Box 3240

91050 Erlangen

E-mail: publishing-distribution@publicis.de

Internet: www.publicis-books.de

ISBN 978-3-89578-412-5

6th edition, 2012

Editor: Siemens Aktiengesellschaft, Berlin and Munich

Publisher: Publicis Publishing, Erlangen

© 2012 by Publicis Erlangen, Zweigniederlassung der PWW GmbH

This publication and all parts thereof are protected by copyright. Any use of it outside the strict provisions of the copyright law without the consent of the publisher is forbidden and will incur penalties. This applies particularly to reproduction, translation, microfilming or other processing, and to storage or processing in electronic systems. It also applies to the use of individual illustrations or extracts from the text.

Printed in Germany

Preface

The SIMATIC automation system unites all the subsystems of an automation solution under a uniform system architecture to form a homogeneous whole from the field level right up to process control. This Totally Integrated Automation (TIA) enables integrated configuring and programming, data management and communications throughout the complete automation system.

As the basic tool for SIMATIC, STEP 7 plays an integrating role in Totally Integrated Automation. STEP 7 is used to configure and program the SIMATIC S7, SIMATIC C7 and SIMATIC WinAC automation systems. Microsoft Windows has been chosen as the operating system to take advantage of the familiar user interface of standard PCs as also used in office environments.

For block programming STEP 7 provides programming languages that comply with DIN EN 6.1131-3: STL (statement list; an Assembler-like language), LAD (ladder logic; a representation similar to relay logic diagrams), FBD (function block diagram) and the S7-SCL optional package (Structured Control Language, a Pascal-like high-level language). Several optional packages supplement these languages: S7-GRAPH (sequential control), S7-HiGraph (programming with state-transition diagrams) and CFC (connecting blocks; similar to function block diagram). The various methods of representation allow every user to select the suitable control function description. This broad adaptability in representing the control task to be solved significantly simplifies working with STEP 7.

This book describes the STL and SCL programming languages for S7-300/400. As a valuable supplement to the description of the languages, and following an introduction to the S7-300/400 automation system, it provides valuable, practice-oriented information on the basic han-

dling of STEP 7 when configuring, networking and programming SIMATIC PLCs. The description of the “Basic Functions” of a binary control, such as logic operations or latching/unlatching functions, makes it particularly easy for first-time users or users changing from relay contactor controls to become acquainted with STEP 7. The digital functions explain how digital values are combined; for example, basic calculations, comparisons or data type conversion.

The book shows how you can control program processing (program flow) and design structured programs. In addition to the cyclically processed main program, you can also incorporate event-driven program sections as well as influence the behavior of the controller at startup and in the event of errors/faults.

One section of the book is dedicated to the description of the SCL programming language. SCL is especially suitable for programming complex algorithms or for tasks in the data management area, and it supplements STL towards higher-level programming languages. The book concludes with the description of a program for converting STEP 5 programs to STEP 7 programs, and a general overview of the system functions and the function set for STL and SCL.

The contents of this book describe Version 5.5 of the STEP 7 programming software and Version 5.3 SP5 of the S7-SCL optional package.

Nuremberg, May 2012

Hans Berger

The Contents of the Book at a Glance

Overview of the S7-300/400 programmable logic controller

PLC functions comparable to a contactor control system

Numbers, manipulating the contents of the accumulators

Program run control, block functions

Introduction	Basic Functions	Digital Functions	Program Flow Control
1 SIMATIC S7-300/400 Programmable Controller Structure of the Programmable Controller (Hardware Components of S7-300/400); Memory Areas; Distributed I/O (PROFIBUS DP); Communications (Subnets); Modules Addresses; Addresses Areas	4 Binary Logic Operations AND, OR and Exclusive OR Functions; Nesting Functions	9 Comparison Functions Comparison According to Data Types INT, DINT and REAL	15 Status Bits Binary Flags, Digital Flags; EN/ENO Mechanism
2 STEP 7 Programming Software Editing Projects; Configuring Stations; Configuring the Network; Symbol Editor; STL Program Editor; SCL Program Editor; Online Mode; Testing the Program	5 Memory Functions Assign, Set and Reset; Edge Evaluation; Example of a Conveyor Belt Control System	10 Arithmetic Functions Four-function Math with INT, DINT and REAL numbers; Adding Constants, Decrementing and Incrementing	16 Jump Functions Unconditional Jump; Jumps Conditional on the RLO, BR and the Digital Flags; Jump Distributor, Loop Jump
	6 Move Functions Load Functions, Transfer Functions; Accumulator Functions; System Functions for Data Transfer	11 Math Functions Trigonometric Functions; Arc Functions; Powers, Logarithm	17 Master Control Relay MCR Dependency, MCR Area, MCR Zone
3 SIMATIC S7 Program Program Processing; Block Types; Programming STL and SCL Code Blocks; Programming Data Blocks; Addressing Variables, Constant Representations, Data Types (Overview)	7 Timer Functions Start SIMATIC Timers with Five Different Types; IEC Timers	12 Converting Functions Data Type Conversion; Complement Formation	18 Block Functions Block Call, Block End; Temporary and Static Local Data; Data Addresses
	8 Counter Functions SIMATIC Counters; Count up, Count down, Set, Reset and Scan Counters; IEC Counters	13 Shift Functions Shifting and Rotating	19 Block Parameters Formal Parameters, Actual Parameters; Declarations, Assignments and "Parameter Passing"
		14 Word Logic AND, OR, Exclusive OR	

Processing the user program

Working with complex variables, indirect addressing

Description of the Programming Language SCL

S5/S7 Converter, block libraries, overviews

Program Processing	Variable Handling	Structured Control Language SCL	Appendix
20 Main Program Program Structure; Scan Cycle Control (Response Time, Start Information, Background Scanning); Program Functions; Communications via Distributed I/O and Global Data; S7 and S7-Basic Communications	24 Data Types Structure of the Data Types, Declaration and Use of Elementary and Complex Data Types; Programming of User Defined Data Types UDT	27 Introduction, Language Elements Addressing, Operators, Expressions, Value Assignments	32 S5/S7 Converter Preparations for Conversion; Converting STEP 5 Programs; Postprocessing
21 Interrupt Handling Time-of-Day Interrupts; Time-Delay Interrupts; Watchdog Interrupts; Hardware Interrupts; DPV1 Interrupts; Multiprocessor Interrupt; Handling Interrupts	25 Indirect Addressing Area Pointer, DB Pointer, ANY Pointer; Indirect Addressing via Memory and Register (Area-internal and Area-crossing); Working with Address Registers	28 Control Statements IF, CASE, FOR, WHILE, REPEAT, CONTINUE, EXIT, GOTO, RETURN	33 Block Libraries Organization Blocks; System Function Blocks; IEC Function Blocks; S5-S7 Converting Blocks; TI-S7 Converting Blocks; PID Control Blocks; DP Functions
22 Restart Characteristics Cold Restart, Hot Restart, Warm Restart; STOP, HOLD, Memory Reset; Parameterizing Modules	26 Direct Variable Access Load Variable Address Data Storage of Variables in the Memory; Data Storage when Transferring Parameters; "Variable" ANY Pointer; Brief Description of the "Message Frame Example"	29 SCL Block Calls Function Value; OK Variable, EN/ENO Mechanism, Description of Examples	34 STL Operation Overview Basic Functions; Digital Functions; Program Flow Control; Indirect Addressing
23 Error Handling Synchronous Errors; Asynchronous Errors; System Diagnostics	30 SCL Functions Timer Functions; Counter Functions; Conversion and Math Functions; Shifting and Rotating	31 IEC Functions Conversion and Comparison Functions; STRING Functions; Date/Time-of-Day Functions; Numerical Functions	35 SCL Statement and Function Overview Operators; Control Statements; Block Calls; Standard Functions

The Programming Examples

The present book provides many figures representing the use of the STL and SCL programming languages. All programming examples can be downloaded from the publisher's website www.publicis-books.de. There are two libraries, one for STL examples (STL_Book) and one for SCL examples (SCL_Book). When dearchived with the Retrieve function, these libraries occupy approximately 2.9 or 1.7 MB (dependent on the PG/PC file system used).

The library STL_Book contains eight programs that are essentially illustrations of the STL method of representation. Two extensive examples show the programming of functions, function blocks and local instances (Conveyor Example) and the handling of data (Message Frame Example). All the examples exist as source files and contain symbols and comments.

The library SCL_Book contains five programs with representations of the SCL statements and

Library STL_Book

Basic Functions Examples of STL representation	Program Processing Examples of SFC Calls
FB 104 Chapter 4: Binary Logic Operations	FB 120 Chapter 20: Main Program
FB 105 Chapter 5: Memory Functions	FB 121 Chapter 21: Interrupt Handling
FB 106 Chapter 6: Transfer Functions	FB 122 Chapter 22: Restart Characteristics
FB 107 Chapter 7: Timer Functions	FB 123 Chapter 23: Error Handling
FB 108 Chapter 8: Counter Functions	
Digital Functions Examples of STL representation	Variable Handling Examples of Data Types and Variable Processing
FB 109 Chapter 9: Comparison Functions	FB 124 Chapter 24: Data Types
FB 110 Chapter 10: Arithmetic Functions	FB 125 Chapter 25: Indirect Addressing
FB 111 Chapter 11: Math Functions	FB 126 Chapter 26: Direct Variable Access
FB 112 Chapter 12: Conversion Functions	FB 101 Elementary Data Types
FB 113 Chapter 13: Shift Functions	FB 102 Complex Data Types
FB 114 Chapter 14: Word Logic	FB 103 Parameter Types
Program Flow Control Examples of STL representation	Conveyor Example Examples of Basic Functions and Local Instances
FB 115 Chapter 15: Status Bits	FC 11 Conveyor Belt Controller
FB 116 Chapter 16: Jump Functions	FC 12 Counter Control
FB 117 Chapter 17: Master Control Relay	FB 20 Feed
FB 118 Chapter 18: Block Functions	FB 21 Conveyor Belt
FB 119 Chapter 19: Block Parameters	FB 22 Parts Counter
Source File Block Programming (Chapter 3)	
Message Frame Example Handling Data examples	General Examples
UDT 51 Data Structure Header	FC 41 Range Monitor
UDT 52 Data Structure Message Frame	FC 42 Limit Value Detection
FB 51 Generate Message Frame	FC 43 Compound Interest Calculation
FB 52 Save Message Frame	FC 44 Double-Word-Wise Edge Evaluation
FC 61 Clock Check	FC 45 Converting S5 Floating-Point to S7 REAL
FC 62 Generate Checksum	FC 46 Converting S7 REAL to S5 Floating-Point
FC 63 Convert Date	FC 47 Copy Data Area (ANY Pointer)

the SCL functions. The programs “Conveyor Example” The library SCL_Book contains five programs with representations of the SCL statements and the SCL functions. The programs “Conveyor Example” and “Message Frame Example” and “Message Frame Example” show the same functions as the STL examples of the same name. The program “General Examples” contains SCL functions for processing complex data types, data storage and – for SCL program-

mers – a statement for programming simple STL functions for SCL programs.

To try the programs out, set up a project corresponding to your hardware configuration and then copy the program, including the symbol table from the library to the project. Now you can call the example programs, adapt them for your own purposes and test them online.

Library SCL_Book

27 Language Elements Examples of SCL Representation (Chapter 27) FC 271 Delimiter Example OB 1 Main Program for the Delimiter Example FB 271 Operators, Expressions, Assignments FB 272 Indirect Addressing	30 SCL Functions Examples of SCL Representation (Chapter 30) FB 301 Timer Functions FB 302 Counter Functions FB 303 Conversion Functions FB 304 Math Functions FB 305 Shifting and Rotating
28 Control Statements Examples of SCL Representation (Chapter 28) FB 281 IF Statement FB 282 CASE Statement FB 283 FOR Statement FB 284 WHILE Statement FB 285 REPEAT Statement	31 IEC Functions Examples of SCL Representation (Chapter 31) FB 311 Conversion Functions FB 312 Comparison Functions FB 313 String Functions FB 314 Date/Time-of-day Functions FB 315 Numerical Functions
29 SCL Block Calls Examples of SCL Representation (Chapter 29) FC 291 FC Block with Function Value FC 292 FC Block without Function Value FB 291 FB Block FB 292 Example Calls for FC and FB Blocks FC 293 FC Block for EN/ENO Example FB 293 FB Block for EN/ENO Example FB 294 Calls for EN/ENO Examples	General Examples FC 61 DT_TO_STRING FC 62 DT_TO_DATE FC 63 DT_TO_TOD FB 61 Variable Length FB 62 Checksum FB 63 Ring Buffer FB 64 FIFO Register STL Functions for SCL Programming
Conveyor Example Examples of Basic Functions and Local Instances FC 11 Conveyor Belt Controller FC 12 Counter Control FB 20 Feed FB 21 Conveyor Belt FB 22 Parts Counter	Message Frame Example Handling Data examples UDT 51 Data Structure Header UDT 52 Data Structure Message Frame FB 51 Generate Message Frame FB 52 Save Message Frame FC 61 Clock Check

Automating with STEP 7


This double page shows the basic procedure for using the STEP 7 programming software.

Start the SIMATIC Manager and set up a new project or open an existing project. All the data for an automation task are stored in the form of objects in a project. When you set up a project, you create containers for the accumulated data by setting up the required stations with at least the CPUs; then the containers for the user programs are also created. You can also create a program container direct in the project.

In the next steps, you configure the hardware and, if applicable, the communications connections. Following this, you create and test the program.

The order for creating the automation data is not fixed. Only the following general regulation applies: if you want to process objects (data), they must exist; if you want to insert objects, the relevant containers must be available.

You can interrupt processing in a project at any time and continue again from any location the next time you start the SIMATIC Manager.

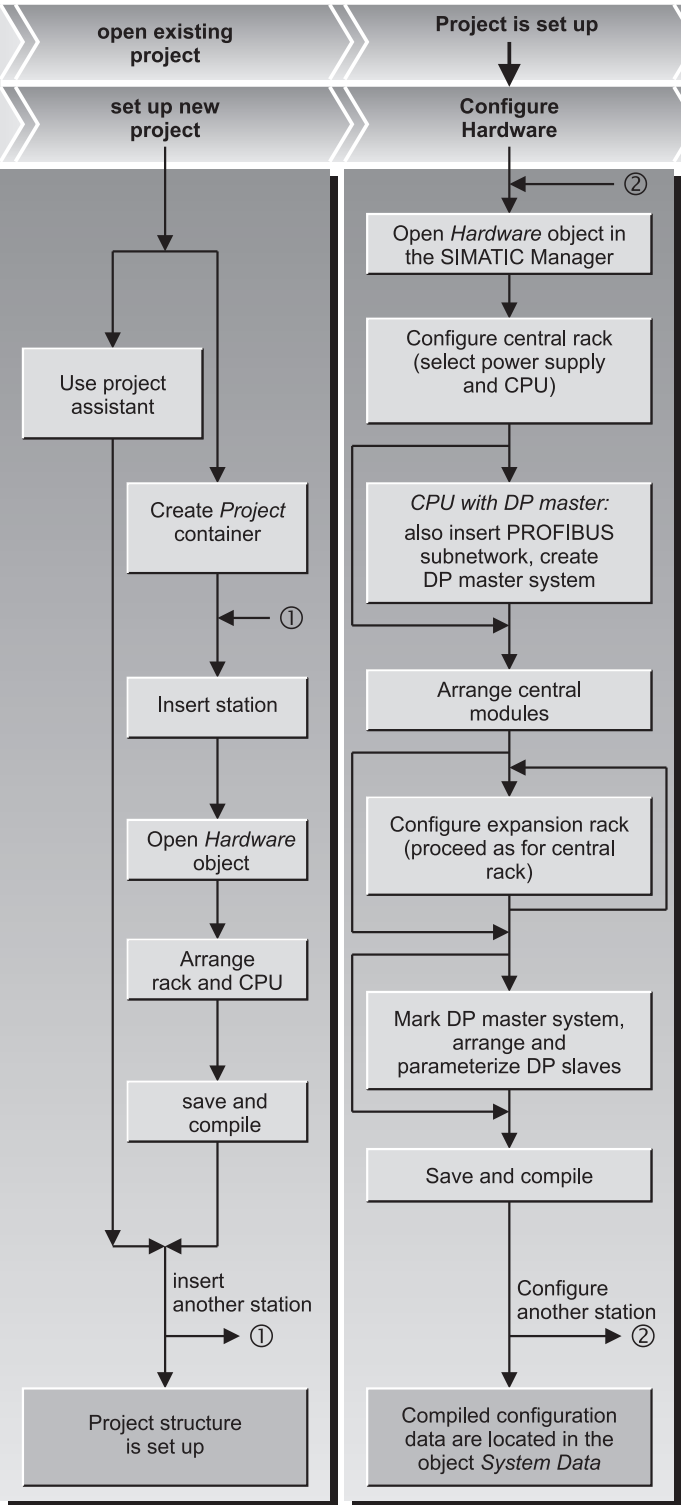

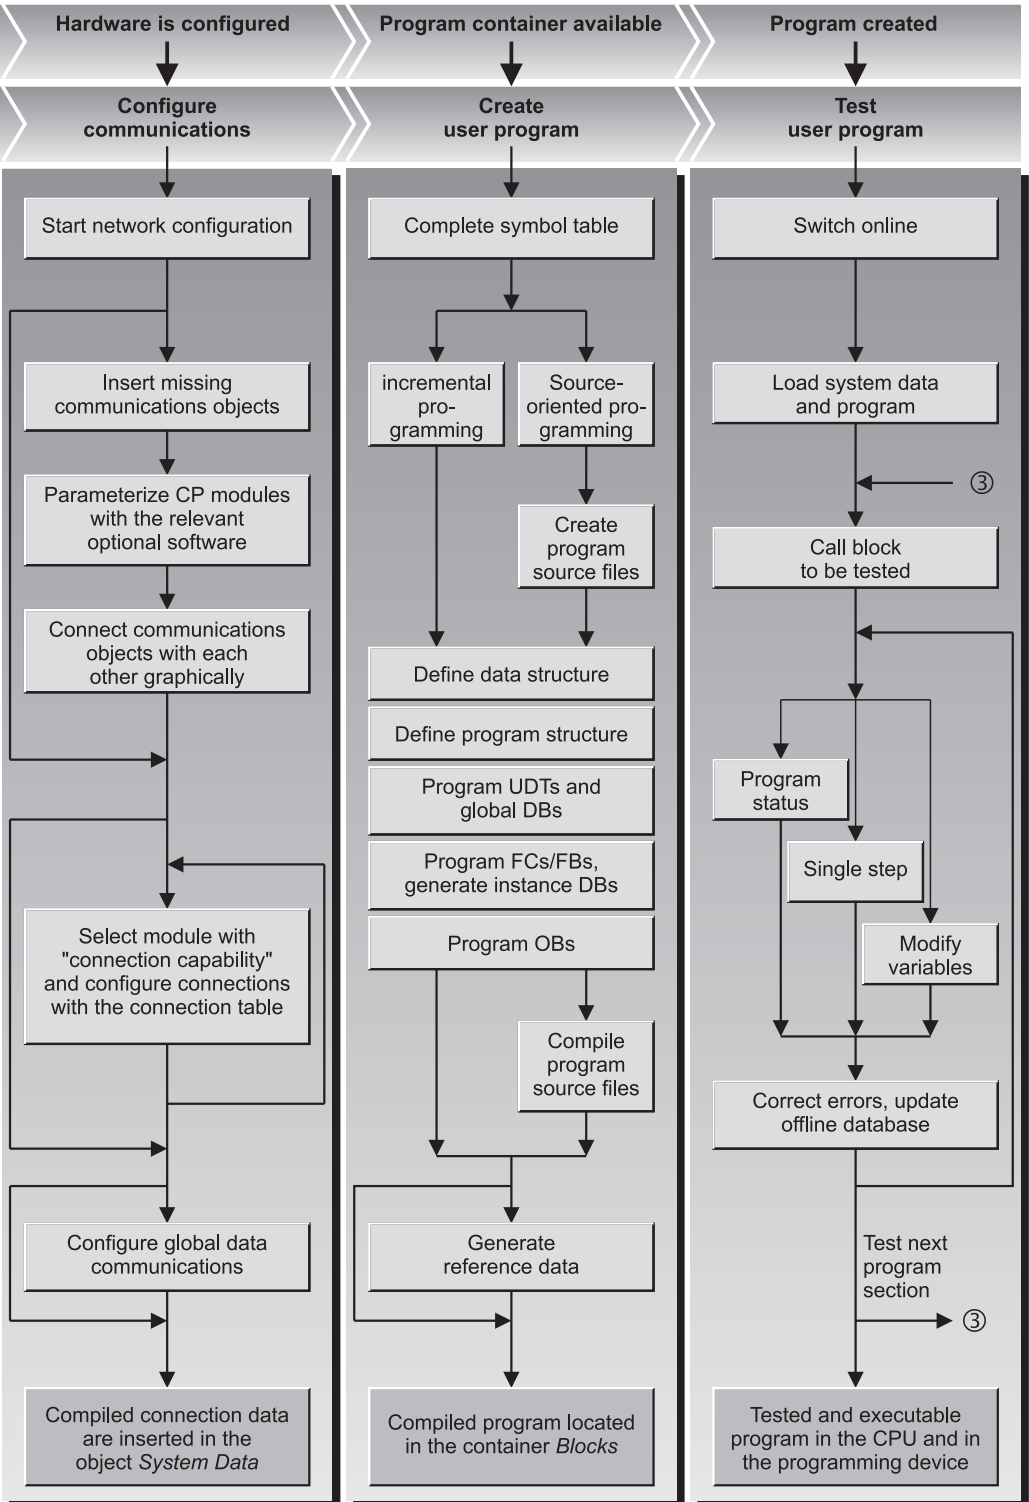


Table of Contents

Preface	5	2	STEP 7 Programming Software	51
Automating with STEP 7	10	2.1	STEP 7 Basic Package	51
Introduction	21	2.1.1	Installation	51
1 SIMATIC S7-300/400		2.1.2	Automation License Manager . .	51
Programmable Controller	22	2.1.3	SIMATIC Manager	52
1.1 Structure of the		2.1.4	Projects and Libraries	53
Programmable Controller	22	2.1.5	Multiprojects	55
1.1.1 Components	22	2.1.6	Online Help.	56
1.1.2 S7-300 Station	22	2.2	Editing Projects	56
1.1.3 S7-400 Station	24	2.2.1	Creating Projects	56
1.1.4 Fault-Tolerant SIMATIC	25	2.2.2	Managing, Rearranging and	
1.1.5 Safety-related SIMATIC	26		Archiving	58
1.1.6 CPU Memory Areas	27	2.2.3	Project Versions	58
1.2 Distributed I/O	30	2.2.4	Creating and Editing Multiprojects	59
1.2.1 PROFIBUS DP	30	2.3	Configuring Stations	60
1.2.2 PROFINET IO	32	2.3.1	Arranging Modules	62
1.2.3 Actuator/Sensor Interface	33	2.3.2	Addressing Modules	62
1.2.4 Routers	35	2.3.3	Parameterizing Modules	63
1.3 Communications	37	2.3.4	Networking Modules with MPI .	63
1.3.1 Introduction	37	2.3.5	Monitoring and Modifying	
1.3.2 Subnets	39		Modules	64
1.3.3 Communications Services	42	2.4	Configuring the Network	64
1.3.4 Connections	44	2.4.1	Configuring the Network View .	66
1.4 Module Addresses	44	2.4.2	Configuring Distributed I/O with	
1.4.1 Signal Path	44		the Network Configuration	66
1.4.2 Slot Address	45	2.4.3	Configuring Connections	67
1.4.3 Logical Address	46	2.4.4	Network Transitions	70
1.4.4 Module Start Address	46	2.4.5	Loading the Connection Data . .	71
1.4.5 Diagnostics Address	46	2.4.6	Adjusting Projects in the	
1.4.6 Addresses for Bus Nodes	47		Multiproject	71
1.5 Address Areas	47	2.5	Creating the S7 Program	73
1.5.1 User Data Area	47	2.5.1	Introduction	73
1.5.2 Process Image	48	2.5.2	Symbol Table	73
1.5.3 Consistent User Data	49	2.5.3	STL-Program Editor	75
1.5.4 Bit Memories	50	2.5.4	SCL Program Editor	80
		2.5.5	Rewiring	83
		2.5.6	Address Priority	83
		2.5.7	Reference Data	84
		2.5.8	Language Settings	86

19.1.2	Processing the Block Parameters	261	20.4.6	Special functions for PROFINET IO	321
19.1.3	Declaration of the Block Parameters	262	20.4.7	System Blocks for the Distributed I/O	329
19.1.4	Declaration of the Function Value	263	20.5	Global Data Communication	337
19.1.5	Initializing Block Parameters	264	20.5.1	Fundamentals	337
19.2	Formal Parameters	264	20.5.2	Configuring GD Communication	339
19.3	Actual Parameters	267	20.5.3	System Functions for GD Communication	341
19.4	“Passing On” Block Parameters	270	20.6	S7 Basic Communication	342
19.5	Examples	271	20.6.1	Station-Internal S7 Basic Communication	342
19.5.1	Conveyor Belt Example	271	20.6.2	System Functions for Data Interchange within a Station	343
19.5.2	Parts Counter Example	272	20.6.3	Station-External S7 Basic Communication	344
19.5.3	Feed Example	272	20.6.4	System Functions for Station- External S7 Basic Communication	345
Program Processing		276	20.7	S7 Communication	347
20	Main Program	277	20.7.1	Fundamentals	347
20.1	Program Organization	277	20.7.2	Two-Way Data Exchange	349
20.1.1	Program Structure	277	20.7.3	One-Way Data Exchange	351
20.1.2	Program Organization	278	20.7.4	Transferring Print Data	352
20.2	Scan Cycle Control	279	20.7.5	Control Functions	352
20.2.1	Process Image Updating	279	20.7.6	Monitoring Functions	353
20.2.2	Scan Cycle Monitoring Time	281	20.8	IE Communication	356
20.2.3	Minimum Scan Cycle Time, Background Scanning	282	20.8.1	Fundamentals	356
20.2.4	Response Time	283	20.8.2	Establishment and Cancellation of Connections	358
20.2.5	Start Information	283	20.8.3	Data Transmission with TCP Native or ISO-on-TCP	360
20.3	Program Functions	285	20.8.4	Data Transmission with UDP	361
20.3.1	Time	285	20.9	PtP Communication with S7-300C	363
20.3.2	Read System Clock	287	20.9.1	Fundamentals	363
20.3.3	Run-Time Meter	287	20.9.2	ASCII Driver and 3964(R) Procedure	364
20.3.4	Compressing CPU Memory	289	20.9.3	RK512 Computer Link	366
20.3.5	Waiting and Stopping	289	20.10	Configuration in RUN	368
20.3.6	Multiprocessing Mode	289	20.10.1	Preparation of Modifications to Configuration	369
20.3.7	Determining OB Program Execution Time	290	20.10.2	Changing the Configuration	370
20.3.8	Changing the Program Protection	292	20.10.3	Loading the Configuration	371
20.4	Communication via Distributed I/O	294	20.10.4	CiR Synchronization Time	371
20.4.1	Addressing PROFIBUS DP	294	20.10.5	Effects on Program Execution	371
20.4.2	Configuring PROFIBUS DP	298	20.10.6	Controlling the CiR Procedure	372
20.4.3	Special Functions for PROFIBUS DP	307			
20.4.4	Addressing PROFINET IO	312			
20.4.5	Configuring PROFINET IO	315			

21	Interrupt Handling	373	22.2	Power-Up	395
21.1	General Remarks.	373	22.2.1	STOP Mode.	395
21.2	Time-of-Day Interrupts	374	22.2.2	Memory Reset.	395
21.2.1	Handling Time-of-Day Interrupts	375	22.2.3	Restoration of Delivery State . .	396
21.2.2	Configuring Time-of-Day Interrupts with STEP 7.	376	22.2.4	Retentivity	396
21.2.3	System Functions for Time-of-Day Interrupts.	376	22.2.5	Restart Parameterization	396
21.3	Time-Delay Interrupts	378	22.3	Types of Restart.	397
21.3.1	Handling Time-Delay Interrupts. .	378	22.3.1	START-UP Mode.	397
21.3.2	Configuring Time-Delay Interrupts with STEP 7.	379	22.3.2	Cold Restart.	397
21.3.3	System Functions for Time-Delay Interrupts.	379	22.3.3	Warm Restart	399
21.4	Watchdog Interrupts	380	22.3.4	Hot Restart	400
21.4.1	Handling Watchdog Interrupts. .	381	22.4	Ascertaining a Module Address	400
21.4.2	Configuring Watchdog Interrupts with STEP 7	382	22.5	Parameterizing Modules	403
21.5	Hardware Interrupts	382	22.5.1	General Remarks on Parameterizing Modules	403
21.5.1	Generating a Hardware Interrupt	382	22.5.2	System Blocks for Module Parameterization	405
21.5.2	Servicing Hardware Interrupts. .	383	22.5.3	Blocks for Data Record Transfer	407
21.5.3	Configuring Hardware Interrupts with STEP 7	384	23	Error Handling	409
21.6	DPV1 Interrupts	384	23.1	Synchronous Errors	409
21.7	Multiprocessor Interrupt	386	23.2	Synchronous Error Handling . .	411
21.8	Synchronous Cycle Interrupts . .	387	23.2.1	Error Filters	411
21.8.1	Processing Synchronous Cycle Interrupts.	387	23.2.2	Masking Synchronous Errors . .	412
21.8.2	Isochronous Updating of Process Image.	388	23.2.3	Unmasking Synchronous Errors	412
21.8.3	Programming of Synchronous Cycle Interrupts with STEP 7 . .	389	23.2.4	Reading the Error tab	412
21.9	Handling Interrupts	389	23.2.5	Entering a Substitute Value. . .	413
21.9.1	Disabling and Enabling Interrupts	389	23.3	Asynchronous Errors	414
21.9.2	Delaying and Enabling Delayed Interrupts.	390	23.4	System Diagnostics	416
21.9.3	Reading Additional Interrupt Information.	391	23.4.1	Diagnostic Events and Diagnostic Buffer	416
22	Restart Characteristics.	393	23.4.2	Writing User Entries in the Diagnostic Buffer	416
22.1	General Remarks.	393	23.4.3	Evaluating Diagnostic Interrupts	417
22.1.1	Operating Modes.	393	23.4.4	Reading the System Status List .	419
22.1.2	HOLD Mode.	394	23.5	Web Server	420
22.1.3	Disabling the Output Modules. .	394	23.5.1	Activate Web Server	420
22.1.4	Restart Organization Blocks . . .	394	23.5.2	Reading Web Information . . .	420
			23.5.3	Web Information	420
			Variable Handling	422	
24	Data Types	423			
24.1	Elementary Data Types	423			
24.1.1	Declaration of Elementary Data Types	423			

33	Block Libraries	528		
33.1	Organization Blocks	528	34.2.2	Math Functions 540
33.2	System Function Blocks	529	34.2.3	Arithmetic Functions 540
33.3	IEC Function Blocks	532	34.2.4	Conversion Functions 540
33.4	S5-S7 Converting Blocks	533	34.2.5	Shift Functions 540
33.5	TI-S7 Converting Blocks	534	34.2.6	Word Logic Operations. 540
33.6	PID Control Blocks	535	34.3	Program Flow Control 541
33.7	Communication Blocks	535	34.3.1	Jump Functions 541
33.8	Miscellaneous Blocks	535	34.3.2	Master Control Relay. 541
33.9	SIMATIC_NET_CP.	536	34.3.3	Block Functions 541
33.10	Redundant IO MGP V31	537	34.4	Indirect Addressing. 541
33.11	Redundant IO CGP V40.	537	35	SCL Statement and
33.12	Redundant IO CGP V51.	537		Function Overview 542
34	STL Operation Overview . . .	538	35.1	Operators 542
34.1	Basic Functions	538	35.2	Control Statements 542
34.1.1	Binary Logic Operations	538	35.3	Block Calls 542
34.1.2	Memory Functions	539	35.4	SCL Standard Functions 543
34.1.3	Transfer Functions.	539	35.4.1	Timer Functions 543
34.1.4	Timer Functions	539	35.4.2	Counter Functions 543
34.1.5	Counter Functions	539	35.4.3	Conversion Functions 543
34.2	Digital Functions	539	35.4.4	Math functions 544
34.2.1	Comparison Functions.	539	35.4.5	Shift and Rotate. 544
			Index.	545
			Abbreviations.	553

Introduction

This section of the book provides an overview of the SIMATIC S7-300/400.

The **S7-300/400 programmable controller** is of modular design. The modules with which it is configured can be central (in the vicinity of the CPU) or distributed without any special settings or parameter assignments having to be made. In SIMATIC S7 systems, distributed I/O is an integral part of the system. The CPU, with its various memory areas, forms the hardware basis for processing of the user programs. A load memory contains the complete user program: the parts of the program relevant to its execution at any given time are in a work memory whose short access times are the prerequisite for fast program processing.

STEP 7 is the programming software for S7-300/400 and the automation tool is the SIMATIC Manager. The SIMATIC Manager is an application for the Windows operating systems from Microsoft and contains all functions needed to set up a project. When necessary, the SIMATIC Manager starts additional tools, for example to configure stations, initialize modules, and to write and test programs.

You formulate your automation solution in the STEP 7 programming languages. The **SIMATIC S7 program** is structured, that is to say, it consists of blocks with defined functions that are composed of networks or rungs. Different priority classes allow a graduated interruptibility of the user program currently executing. STEP 7 works with variables of various data types starting with binary variables (data type BOOL) through digital variables (e.g. data type INT or REAL for computing tasks) up to complex data types such as arrays or structures (combinations of variables of different types to form a single variable).

The first chapter contains an overview of the hardware of the S7-300/400 automation system and the second chapter contains the same over-

view of the STEP 7 programming software. The basis of the description is the functional scope for STEP 7 Version 5.5.

Chapter 3 “SIMATIC S7 Program” serves as an introduction to the most important elements of an S7 program and shows the programming of individual blocks in the programming languages STL and SCL. The functions and statements of STL and SCL are then described in the subsequent chapters of the book. All the descriptions are explained using brief examples.

- 1 **SIMATIC S7-300/400 Programmable Controller**
Structure of the programmable controller; distributed I/O; communications; module addresses; address areas
- 2 **STEP 7 Programming Software**
SIMATIC Manager; processing a project; configuring a station; configuring a network; writing programs (symbol table, program editor); switching online; testing programs
- 3 **SIMATIC S7 Program**
Program processing with priority classes; program blocks; addressing variables; programming blocks with STL and SCL; variables and constants; data types (overview)

1 SIMATIC S7-300/400 Programmable Controller

1.1 Structure of the Programmable Controller

1.1.1 Components

The SIMATIC S7-300/400 is a modular programmable controller comprising the following components:

- ▷ Racks;
Accommodate the modules and connect them to each other
- ▷ Power supply (PS);
Provides the internal supply voltages
- ▷ Central processing unit (CPU);
Stores and processes the user program
- ▷ Interface modules (IMs);
Connect the racks to one another
- ▷ Signal modules (SMs);
Adapt the signals from the system to the internal signal level or control actuators via digital and analog signals
- ▷ Function modules (FMs);
Execute complex or time-critical processes independently of the CPU
- ▷ Communications processors (CPs)
Establish the connection to subsidiary networks (subnets)
- ▷ Subnets
Connect programmable controllers to each other or to other devices

A programmable controller (or station) may consist of several racks, which are linked to one another via bus cables. The power supply, CPU and I/O modules (SMs, FMs and CPs) are plugged into the central rack. If there is not enough room in the central rack for the I/O modules or if you want some or all I/O modules to be separate from the central rack, expansion racks are available which are connected to the central rack via interface modules (Figure 1.1).

It is also possible to connect distributed I/O to a station (see Chapter 1.2.1 “PROFIBUS DP”).

The racks connect the modules with two buses: the I/O bus (or P bus) and the communication bus (or K bus). The I/O bus is designed for high-speed exchange of input and output signals, the communication bus for the exchange of large amounts of data. The communication bus connects the CPU and the programming device interface (MPI) with function modules and communications processors.

1.1.2 S7-300 Station

Centralized configuration

In an S7-300 controller, as many as 8 I/O modules can be plugged into the central rack. Should this single-tier configuration prove insufficient, you have two options for controllers equipped with a CPU 313 or a more advanced CPU:

- ▷ Either choose a two-tier configuration (with IM 365 up to 1 meter between racks)
- ▷ or choose a configuration of up to four tiers (with IM 360 and IM 361 up to 10 meters between racks)


You can operate a maximum of 8 modules in a rack. The number of modules may be limited by the maximum permissible current per rack, which is 1.2 A.

The modules are linked to one another via a backplane bus, which combines the functions of the P and K buses.

Local bus segment

A special feature regarding configuration is the use of the FM 356 application module. An FM 356 is able to “split” a module's backplane bus and to take over control of the remaining modules in the split-off “local bus segment”

Modular design of an S7-300 station

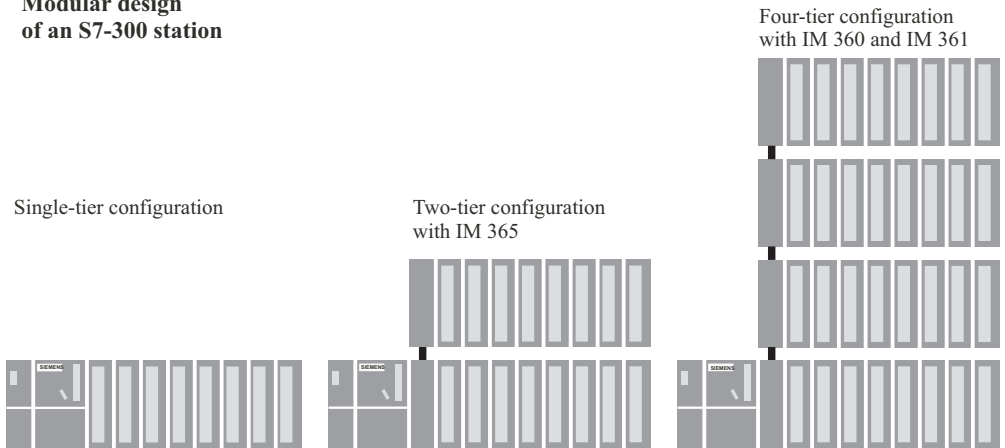

Modular design of an S7-400 station

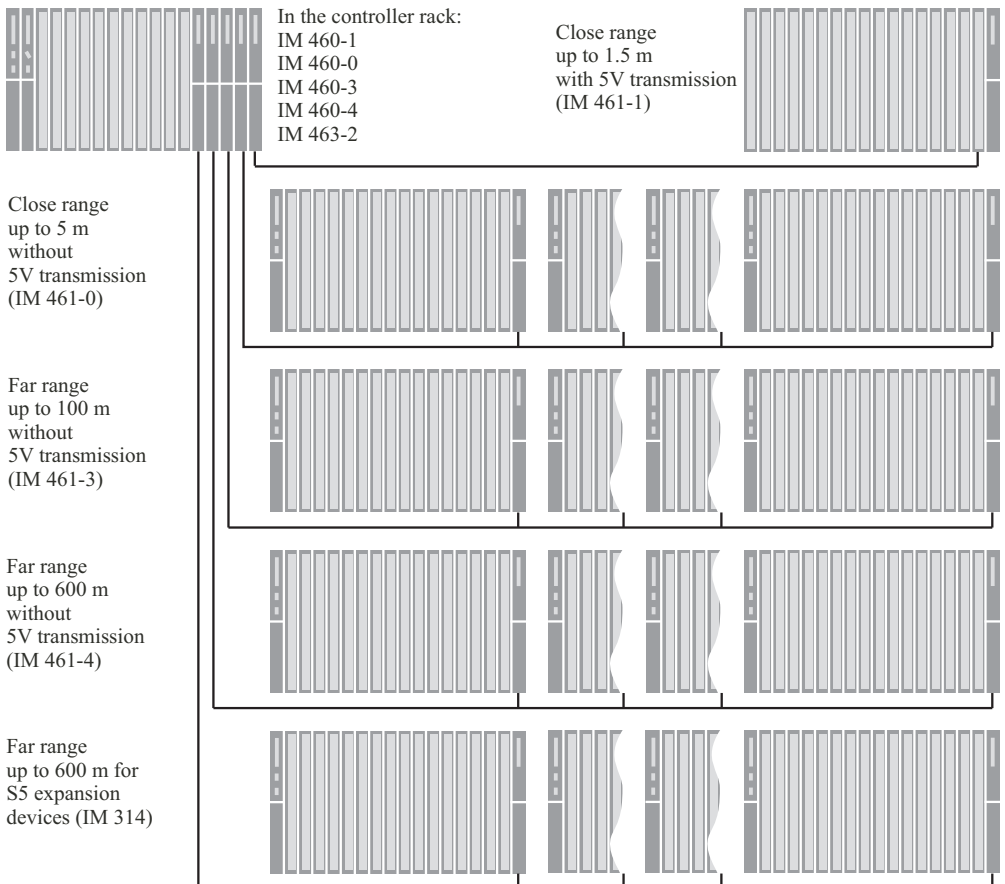


Figure 1.1 Hardware Configuration for S7-300/400

itself. The limitations mentioned above regarding the number of modules and the power consumption also apply in this case.

Standard CPUs

The standard CPUs are available in different versions with regard to memory size and processing speed. They range from the “smallest” CPU 312 for smaller applications with moderate processing speed requirements up to the CPU 319-3 PN/DP with a large program memory and fast program execution for cross-sector automation tasks. Equipped with the corresponding interfaces, some CPUs can be used as the central controller for the distributed I/O over PROFIBUS and PROFINET.

A micro memory card (MMC) is required for using the standard CPUs – as is the case with all innovated S7-300 CPUs. This memory medium opens up new application possibilities compared to the previously used memory card (see Chapter 1.1.6 “CPU Memory Areas”).

The now discontinued CPU 318 can be replaced by the CPUs 317 or 319.

Compact CPUs

The 3xxC CPUs permit a compact design for mini programmable controllers. Depending on the version, they already contain:

- ▷ Integral I/O
Digital and analog inputs/outputs
- ▷ Integral technological functions
Counting, measurement, control, positioning
- ▷ Integral communications interfaces
PROFIBUS DP master or slave, point-to-point coupling (PtP)

The technological functions are system blocks which use the onboard I/Os of the CPU.

Technology CPUs

The CPUs 3xxT combine open-loop control functions with simple motion control functions. The control section is designed as with a standard CPU. It is configured, parameterized and programmed using STEP 7. The technology objects and the motion control section require the S7-Technology option package that is inte-

grated in the SIMATIC Manager following the installation.

The technology CPUs have a PROFIBUS DP interface which permits use as a DP master or DP slave. The CPUs are used for cross-sector automation tasks in series machine construction, special machine construction, and plant construction.

Fail-safe CPUs

The CPUs 3xxF are used in production plants with increased safety requirements. Corresponding PROFIBUS and PROFINET interfaces allow use of safety-related distributed I/O with the PROFIsafe bus profile (see “S7 Distributed Safety” under 1.1.5 “Safety-related SIMATIC”). Standard modules for normal applications can be used parallel to safety-related operation.

SIPLUS

The SIPLUS product family offers modules that can be used in harsh environments. The SIPLUS components are based on standard devices which have been specially converted for the respective application, for example for an extended temperature range, increased resistance to vibration and shock, or voltage ranges differing from the standard. Please therefore note the technical data for the respective SIPLUS module. In order to carry out the configuration with STEP 7, use the equivalent type (the standard module on which it is based); this is specified, for example, on the module's nameplate.

1.1.3 S7-400 Station

Centralized configuration

The controller rack of the S7-400 is available in the versions UR1 (18 slots), UR2 (9 slots) and CR3 (4 slots). UR1 and UR2 can also be used as expansion racks. The power supply and the CPU also occupy slots in the racks, possibly even two or more per module. If necessary, the number of available slots can be increased using expansion racks: UR1 and ER1 have 18 slots each, UR2 and ER2 have 9 slots each.

Using the IM 460-1 and IM 461-1 interface modules, one expansion rack per interface can be located up to 1.5 m away from the controller rack, and the 5 V supply is also transmitted. Up to 4 expansion racks can also be operated via IM 460-0 and 461-0 in the local range up to 5 m. For longer distances, the IM 460-3 and IM 461-3 or the IM 460-4 and 461-4 enable up to 4 expansion racks to be operated up to 100 m or 600 m away.

A maximum of 21 expansion racks can be connected to a central rack. To distinguish between racks, you set the number of the rack on the coding switch of the receiving IM.

The backplane bus consists of a parallel P bus and a serial K bus. Expansion racks ER1 and ER2 are designed for “simple” signal modules which generate no process interrupts, do not have to be supplied with 24 V voltage via the P bus, require no back-up voltage, and have no K bus connection. The K bus is in racks UR1, UR2 and CR2 either when these racks are used as central racks or expansion racks with the numbers 1 to 6.

Connecting segmented rack

A special feature is the segmented rack CR2. The rack can accommodate two CPUs with a shared power supply while keeping them functionally separate. The two CPUs can exchange data with one another via the K bus, but have completely separate P buses for their own signal modules.

Multiprocessor mode

In an S7-400, as many as four specially designed CPUs in a suitable rack UR can take part in multiprocessor mode. Each module in this station is assigned to only one CPU, both with its address and its interrupts. See Chapters 20.3.6 “Multiprocessing Mode” and 21.7 “Multiprocessor Interrupt” for more details.

Connection of SIMATIC S5 modules

The IM 463-2 interface module allows you to connect S5 expansion units (EG 183U, EG 185U, EG 186U as well as ER 701-2 and ER 701-3) to an S7-400, and also allows centralized expansion of the expansion units. An

IM 314 in the S5 expansion unit handles the link. You can operate all analog and digital modules allowed in these expansion units. An S7-400 can accommodate as many as four IM 463-2 interface modules; as many as four S5 expansion units can be connected in a distributed configuration to each of an IM 463-2's interfaces.

1.1.4 Fault-Tolerant SIMATIC

For applications with high fault tolerance demands for machines and processes, there are two versions of SIMATIC S7 fault-tolerant programmable controllers with a redundant design: software redundancy and S7-400H/FH.

Software redundancy

Using SIMATIC S7-300/400 standard components, you can establish a software-based redundant system with a master station controlling the process and a standby station assuming control in the event of the master failing.

Fault tolerance through software redundancy is suitable for slow processes because transfer to the standby station can require several seconds depending on the configuration of the programmable controllers. The process signals are “frozen” during this time. The standby station then continues operation with the data last valid in the master station.

Redundancy of the input/output modules is implemented with distributed I/O (ET 200M with IM 153-2 interface module for redundant PROFIBUS DP). The software redundancy can be configured with STEP 7 Version 5.2 and higher.

Fault-tolerant SIMATIC S7-400H

The SIMATIC S7-400H is a fault-tolerant programmable controller with redundant configuration comprising two central racks, each with an H CPU and a synchronization module for data comparison via fiber optic cable. Both controllers operate in “hot standby” mode; in the event of a fault, the intact controller assumes operation alone via automatic bumpless transfer. The UR2-H rack with 2x9 slots offers the possibility for also installing a fault-tolerant system in one single rack.

The I/O can have normal availability (single-channel, single-sided configuration) or enhanced availability (single-channel, switched configuration with ET 200M). Communication takes place with a single or redundant bus.

The user program is the same as for a non-redundant device; the redundancy function is provided exclusively by the hardware that is used and is kept hidden from the user. The software package required for configuration is included in STEP 7 from V5.3. The provided standard libraries *Redundant IO* contain blocks for supporting the redundant I/O.

1.1.5 Safety-related SIMATIC

Fail-safe programmable controllers control processes in which the safe state can be achieved by direct switching-off. They are used in plants with increased safety requirements.

The safety functions are mainly located in the safety-related user program of a correspondingly designed CPU and in the failsafe input and output modules. An F-CPU complies with the safety requirements up to AK 6 in accordance with DIN V 19250/DIN V VDE 0801, up to SIL 3 in accordance with IEC 61508, and up to Category 4 in accordance with EN 954-1. Safety functions can be executed parallel to a non-safety-related user program in the same CPU.

Safety-related communication over PROFIBUS DP – also over PROFINET IO with S7 Distributed Safety – uses the PROFIsafe bus profile. This permits transmission of safety-related and non-safety-related data on a single bus cable.

Safety Integrated for the manufacturing industry

S7 Distributed Safety is a failsafe automation system for the protection of machines and personnel mainly for applications with machine controls and in the process industry.

Controllers from the SIMATIC S7-300, S7-400, and ET 200S ranges are available as F-CPU. The safety-related I/O modules are connected to S7-400 over PROFIBUS DP or PROFINET IO using the safety-related PROFIsafe bus profile. With S7-300 and ET 200S, use of safety-related I/O modules is additionally possible in the central rack.

The hardware configuration and programming of the non-safety-related user program are carried out using the standard applications of STEP 7.

The *SIMATIC S7 Distributed Safety* option package is required to program the safety-related parts of the program. With this option package you can use the F-LAD or F-FBD programming languages to create the blocks which contain the safety-related program. Interfacing to the I/O is carried out using the process image as with the standard program. S7 Distributed Safety also includes a library with TÜV-certified safety blocks. There is an additional library available with F-blocks for press and burner controls.

The safety-related user program can be executed parallel to the standard user program. If an error is detected in the safety-related part of the program, the CPU enters the STOP state.

Safety Integrated for the process industry

S7 F/FH Systems is a failsafe automation system based on S7-400 mainly for applications in the process industry. The safety-related I/O modules are connected over PROFIBUS DP using the safety-related PROFIsafe bus profile.

An S7-400 F-CPU is provided with the safety-related control functions by application of an *S7 F Systems Runtime license*. A non-safety-related user program can be executed parallel to the safety-related plant unit.

In addition to fail-safety, the S7-400FH also provides increased availability. If a detected fault results in a STOP of the master CPU, a reaction-free switch is made to the CPU running in hot standby mode. The *S7 H Systems* option package is additionally required for operation as S7-400FH.

The hardware configuration and programming of the non-safety-related user program are carried out using the standard applications of STEP 7.

The *S7 F Systems* option package is additionally required for programming the safety-related program parts, and additionally the *CFC* option package V5.0 SP3 and higher and the *S7-SCL* option package V5.0 and higher.

The safety-related program is programmed using CFC (Continuous Function Chart). Programmed, safety-related function blocks from the supplied F-library can be called and interconnected in this manner. Alongside functions for programming safety functions, they also include fault detection and fault reaction functions. This ensures that if there are failures or errors, the F-system can be stopped in or transferred to a safe mode. If a fault is detected in the safety program, the safety-related part of the plant is switched off, whereas the remaining part can continue to operate.

Fail-safe I/O

Failsafe signal modules (F-modules or F-sub-modules) are required for safety operation. The fail-safety is achieved through the integrated safety functions and the corresponding wiring of sensors and actuators.

The F-modules can also be used in standard applications with enhanced diagnostics requirements. Redundant F-modules can be used with S7 F/FH systems to increase the availability both in standard and safety-related operation.

The failsafe I/O is available in various versions:

- ▷ The fail-safe signal modules in S7-300 design are used in the ET 200M distributed I/O device or – with S7-Distributed Safety – also centrally.
- ▷ Failsafe I/O modules are available for the distributed I/O devices in the designs ET 200S, ET 200pro, and ET 200eco.
- ▷ Failsafe interface modules are also available as F-CPU for the ET 200S and ET 200pro distributed I/O devices.
- ▷ Failsafe DP standard slaves and – with S7-Distributed Safety also IO standard devices – can be used which can handle the PRO-FIsafe bus profile.

Failsafe CPUs and signal modules are also available in SIPLUS design.

1.1.6 CPU Memory Areas

Figure 1.2 shows the memory areas in the programming device, in the CPU, and in the signal modules which are important for your program.

The programming device contains the *off-line data*. These consist of the user program (program code and user data), the system data (e.g. hardware configuration, network and connection configuration) and further project-specific data such as e.g. the symbol table and comments.

The *online data* consists of the user program and the system data on the CPU, stored in two storage areas: the load memory and the work memory. In addition, the system memory is also present here.

Finally, the I/O modules contain memories for the signal statuses of the inputs and outputs.

The central processing units have a slot for a plug-in *memory module*. This memory module also contains the load memory, or parts thereof (see “Physical design of CPU memory”, further below). The memory module is designed as memory card (S7-400-CPU) or as micro memory card (S7-300 CPU and derived ET 200 CPU). A firmware update for the CPU operating system can also be performed via the memory module.

Memory card

The memory submodule for the S7-400 CPU is the memory card (MC). There are two types of memory card: RAM cards and flash EPROM cards.

If you only want to expand the load memory, use a RAM card. A RAM card allows you to modify the entire user program online. This is necessary, for example, for larger programs when testing and during commissioning. RAM memory cards lose their contents when unplugged.

If you want to protect your user program against power failure following testing and commissioning, including configuration data and module parameters, use a flash EPROM card. In this case, load the entire program offline onto the flash EPROM card with the card plugged into the programming device. With the relevant CPUs, you can also load the program online with the memory card plugged into the CPU.

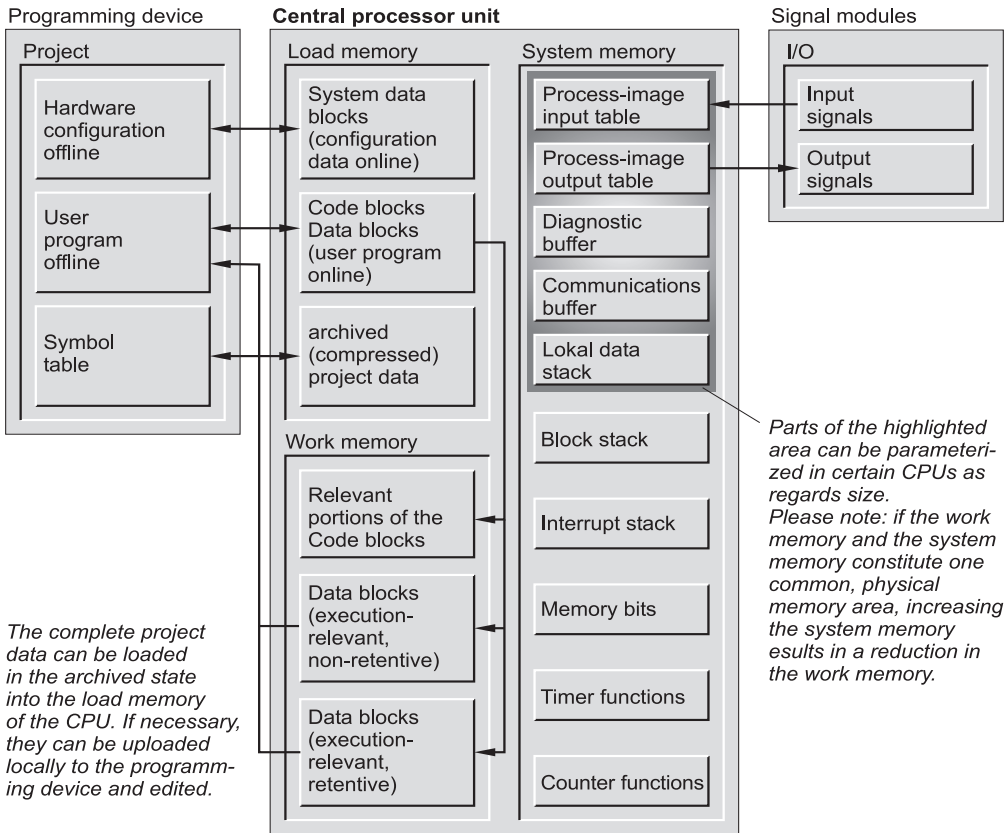


Figure 1.2 Memory areas on the CPU

Micro memory card

The memory submodule for the newer S7-300 CPUs is a micro memory card (MMC). The data on the MMC are non-volatile, but can be read, written and deleted just like with a RAM. This response permits data backup without a battery.

The MMC contains the complete load memory, so that an MMC is always required for operation. The MMC can be used as a portable storage medium for user programs or firmware updates. Using special system functions, you can read or write data blocks on the MMC from the user program, e.g. read recipes from the MMC, or create a measured-value archive on the MMC and provide it with data.

Load memory

The entire user program, including configuration data, is in the load memory (system data). From the programming device, the user program is always initially loaded into the load memory and from there into the work memory. The program in the load memory is not executed as the control program.

With a CPU 300 and a CPU ET200, the load memory is present completely on the micro memory card. Thus the contents of the load memory are retained even if the CPU is de-energized.

If the load memory with a CPU 400 consists of an integrated RAM or RAM memory card, a backup battery is required in order to keep the user program retentive. With an integrated

EEPROM or a plug-in flash EPROM memory card as the load memory, the CPU can be operated without battery backup.

From STEP 7 V5.1 and with appropriately equipped CPUs, you can save all the project data as a compressed archive file in the load memory (see Chapter 2.2.2 “Managing, Rearranging and Archiving”).

Work memory

Work memory is designed in the form of high-speed RAM fully integrated in the CPU. The operating system of the CPU copies the “execution-relevant” program code and the user data into the work memory. “Relevant” is a characteristic of the existing objects and does not mean that a particular code block will necessarily be called and executed. The “actual” control program is executed in the work memory.

Specific to the product, the work memory can be either a coherent area or divided according to program and data memories, where the latter is also divided into retentive and non-retentive parts.

When writing back the user program into the programming device, the blocks are fetched from the load memory, supplemented by the current values of the data addresses from the work memory (further information available in Chapters 2.6.4 “Loading the User Program into the CPU” and 2.6.5 “Block Handling”).

System memory

System memory contains the addresses (variables) that you access in your program. The addresses are combined into areas (address areas) containing a CPU-specific number of addresses. Addresses may be, for example, inputs used to scan the signal states of momentary-contact switches and limit switches, and outputs that you can use to control contactors and lamps.

The system memory on a CPU contains the following address areas:

- ▷ Inputs (I)
Inputs are an image (“process image”) of the digital input modules.

- ▷ Outputs (Q)
Outputs are an image (“process image”) of the digital output modules.
- ▷ Bit memories (M)
are information stores which are directly accessible from any point in the user program.
- ▷ Timers (T)
Timers are locations used to implement waiting and monitoring times.
- ▷ Counters (C)
Counters are software-level locations, which can be used for up and down counting.
- ▷ Temporary local data (L)
Locations used as dynamic intermediate buffers during block processing. The temporary local data are located in the L stack, which the CPU occupies dynamically during program execution.

The letters enclosed in parentheses represent the abbreviations to be used for the different addresses when writing programs. You may also assign a symbol to each variable and then use the symbol in place of the address identifier.

The system memory also contains buffers for communication jobs and system messages (diagnostics buffer). The size of these data buffers, as well as the size of the process input image, the process output image and the L stack, are parameterizable on certain CPUs.

Physical design of CPU memory

The physical design of the load memory differs according to the type of CPU (Figure 1.3).

A CPU 300 or CPU ET 200 does not have an integrated load memory. A micro memory card containing the load memory must always be inserted to permit operation. The load memory can be written and read like a RAM. The physical design means that the number of write operations is limited (no cyclic writing by user program). You can use the menu command COPY RAM TO ROM to transfer the current values of the data operands from the work memory to the load memory.

With a CPU 300 with firmware version V2.0.12 or later, the work memory for the user data consists of a retentive part and a non-retentive part.